

Cambria Enforcement Items

Administrative Civil Liability Complaint

Item # 9 R3-2017-0015

and

Item # 10 Cease and Desist Order R3-2017-0016

Central Coast Regional Water Quality Control Board Meeting

July 13, 2017



Cambria



Relative Locations

Advanced Water Treatment

Hearst San Simeon State Park


Cambria State Marine Conservation Area

Hearst San Simeon State Park

WWTP


Moonstone Beach Park

WEST VILLAGE

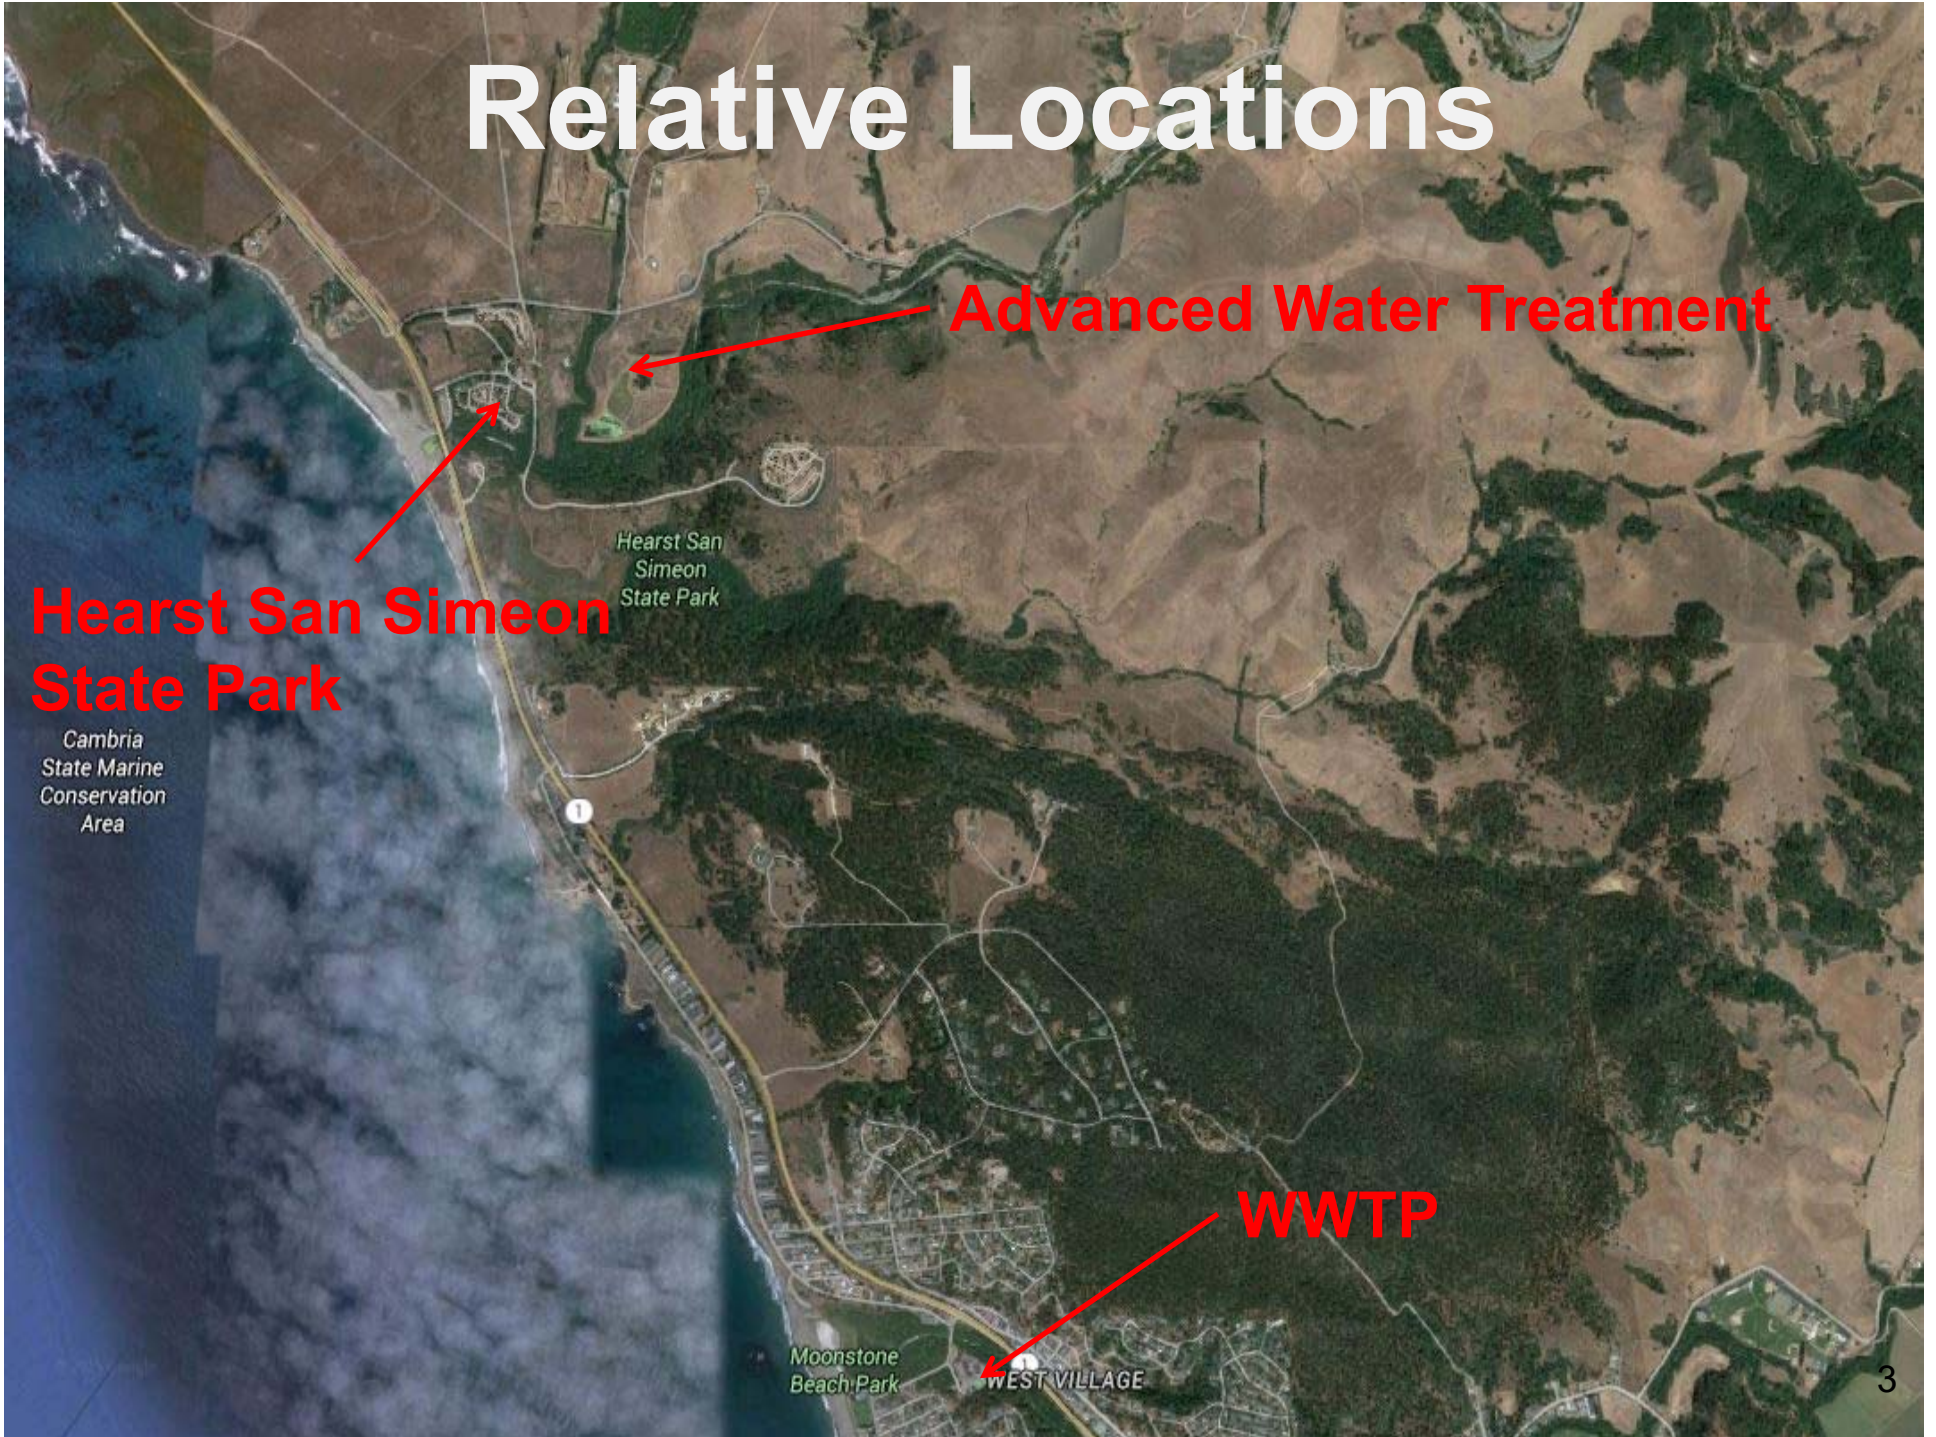

Advanced Treatment System


Designed to treat impaired groundwater to Title 22 standards and re-inject treated water into San Simeon well field aquifer

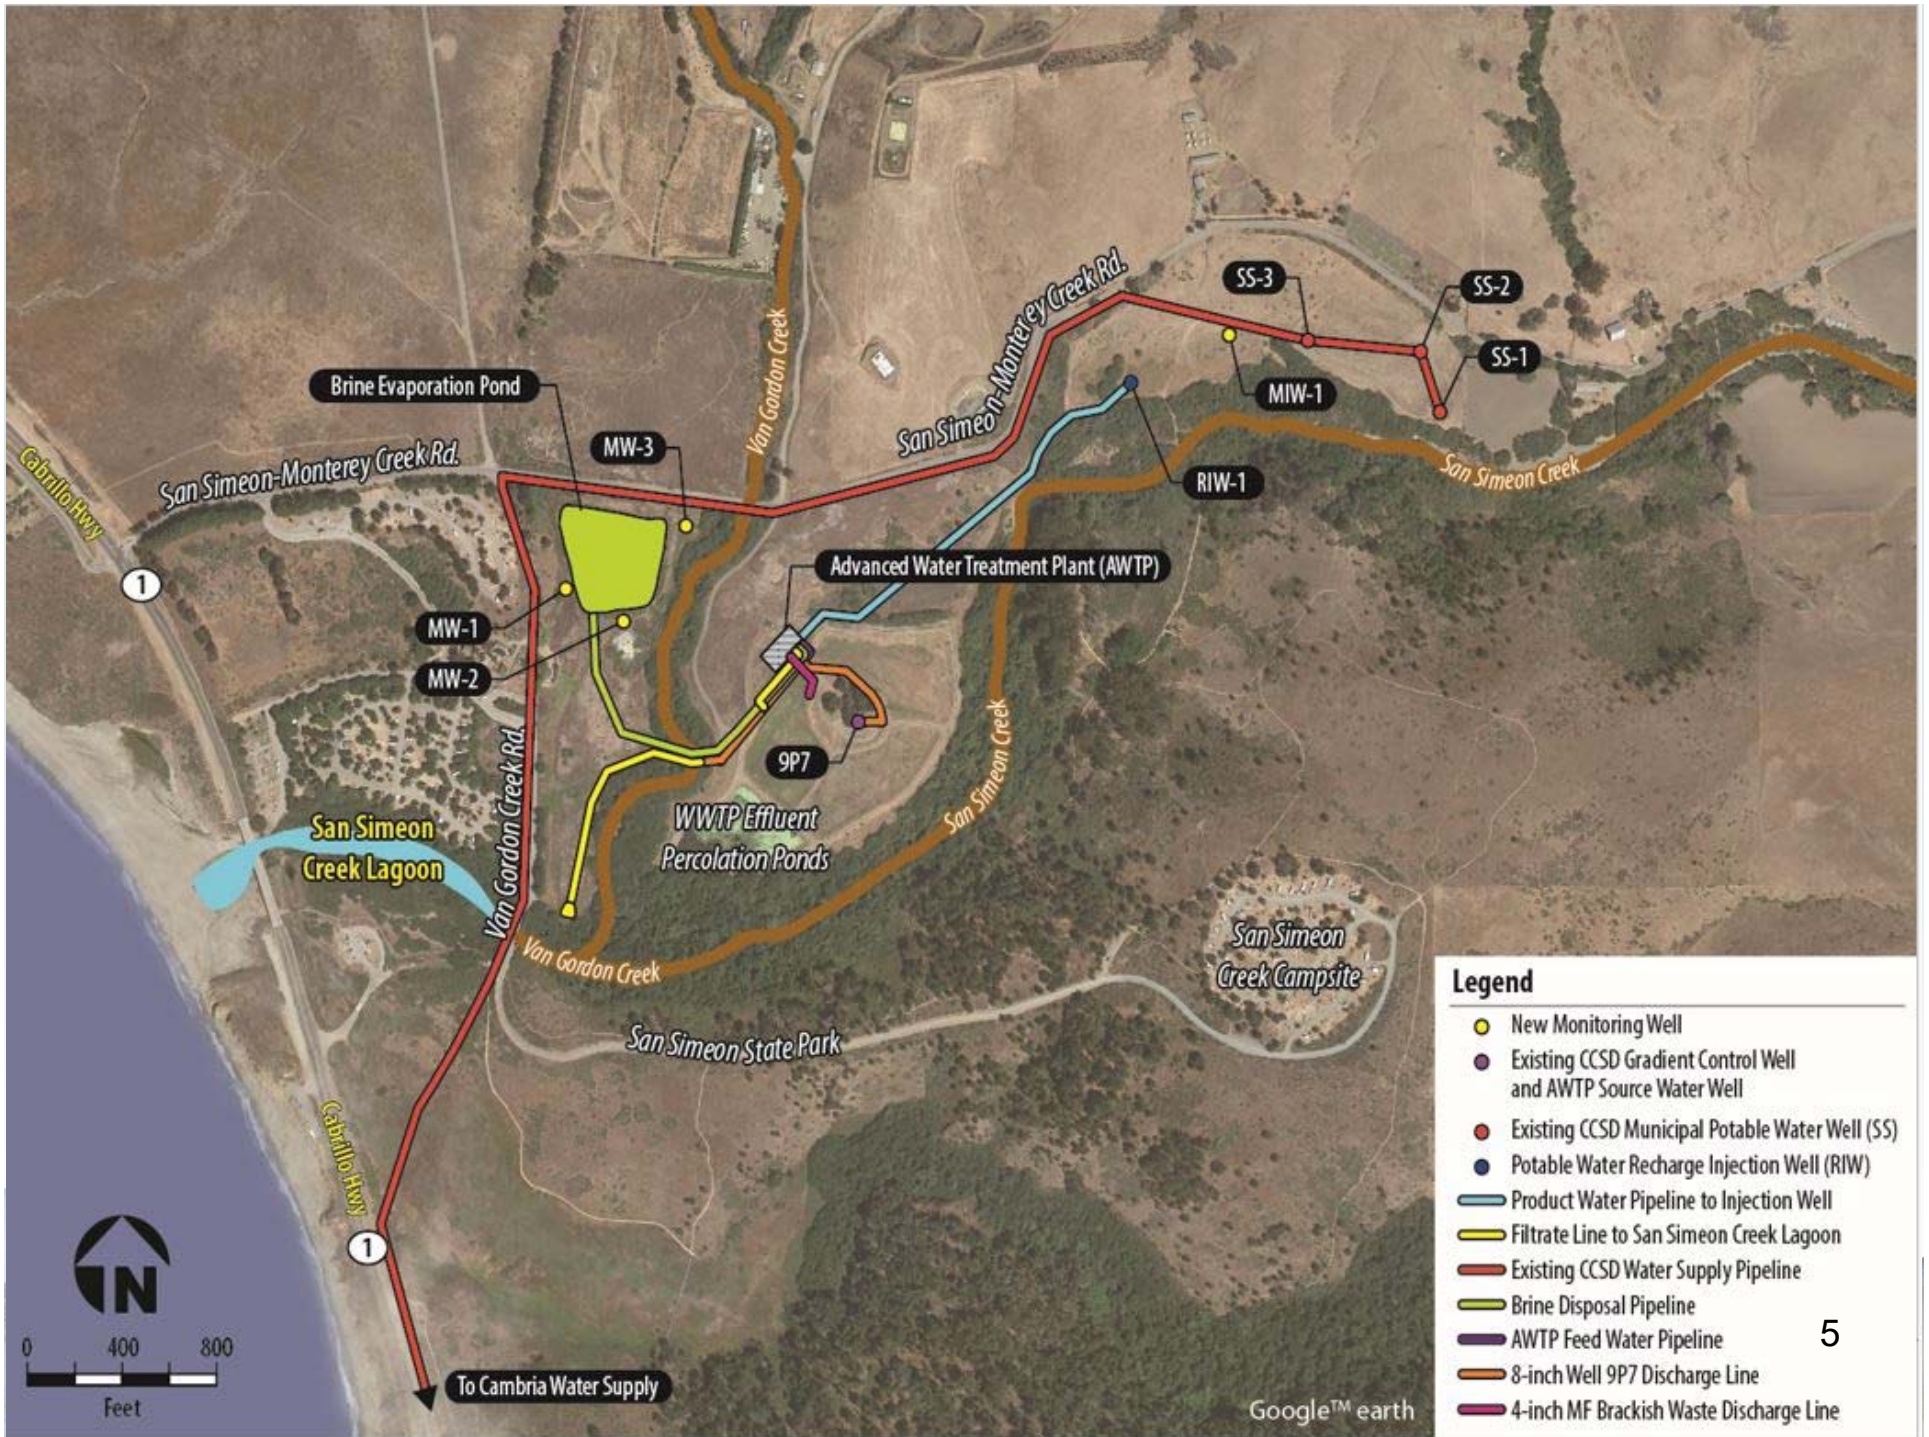

Legend

- New Monitoring Well
- Existing CCSO Gradient Control Well and AWTP Source Water Well
- Existing CCSO Municipal Potable Water Well (SS)
- Potable Water Recharge Injection Well (RIW)
- Product Water Pipeline to Injection Well
- Filtrate Line to San Simeon Creek Lagoon
- Existing CCSO Water Supply Pipeline
- Brine Disposal Pipeline
- AWTP Feed Water Pipeline
- 8-inch Well 9P7 Discharge Line
- 4-inch MF Brackish Waste Discharge Line




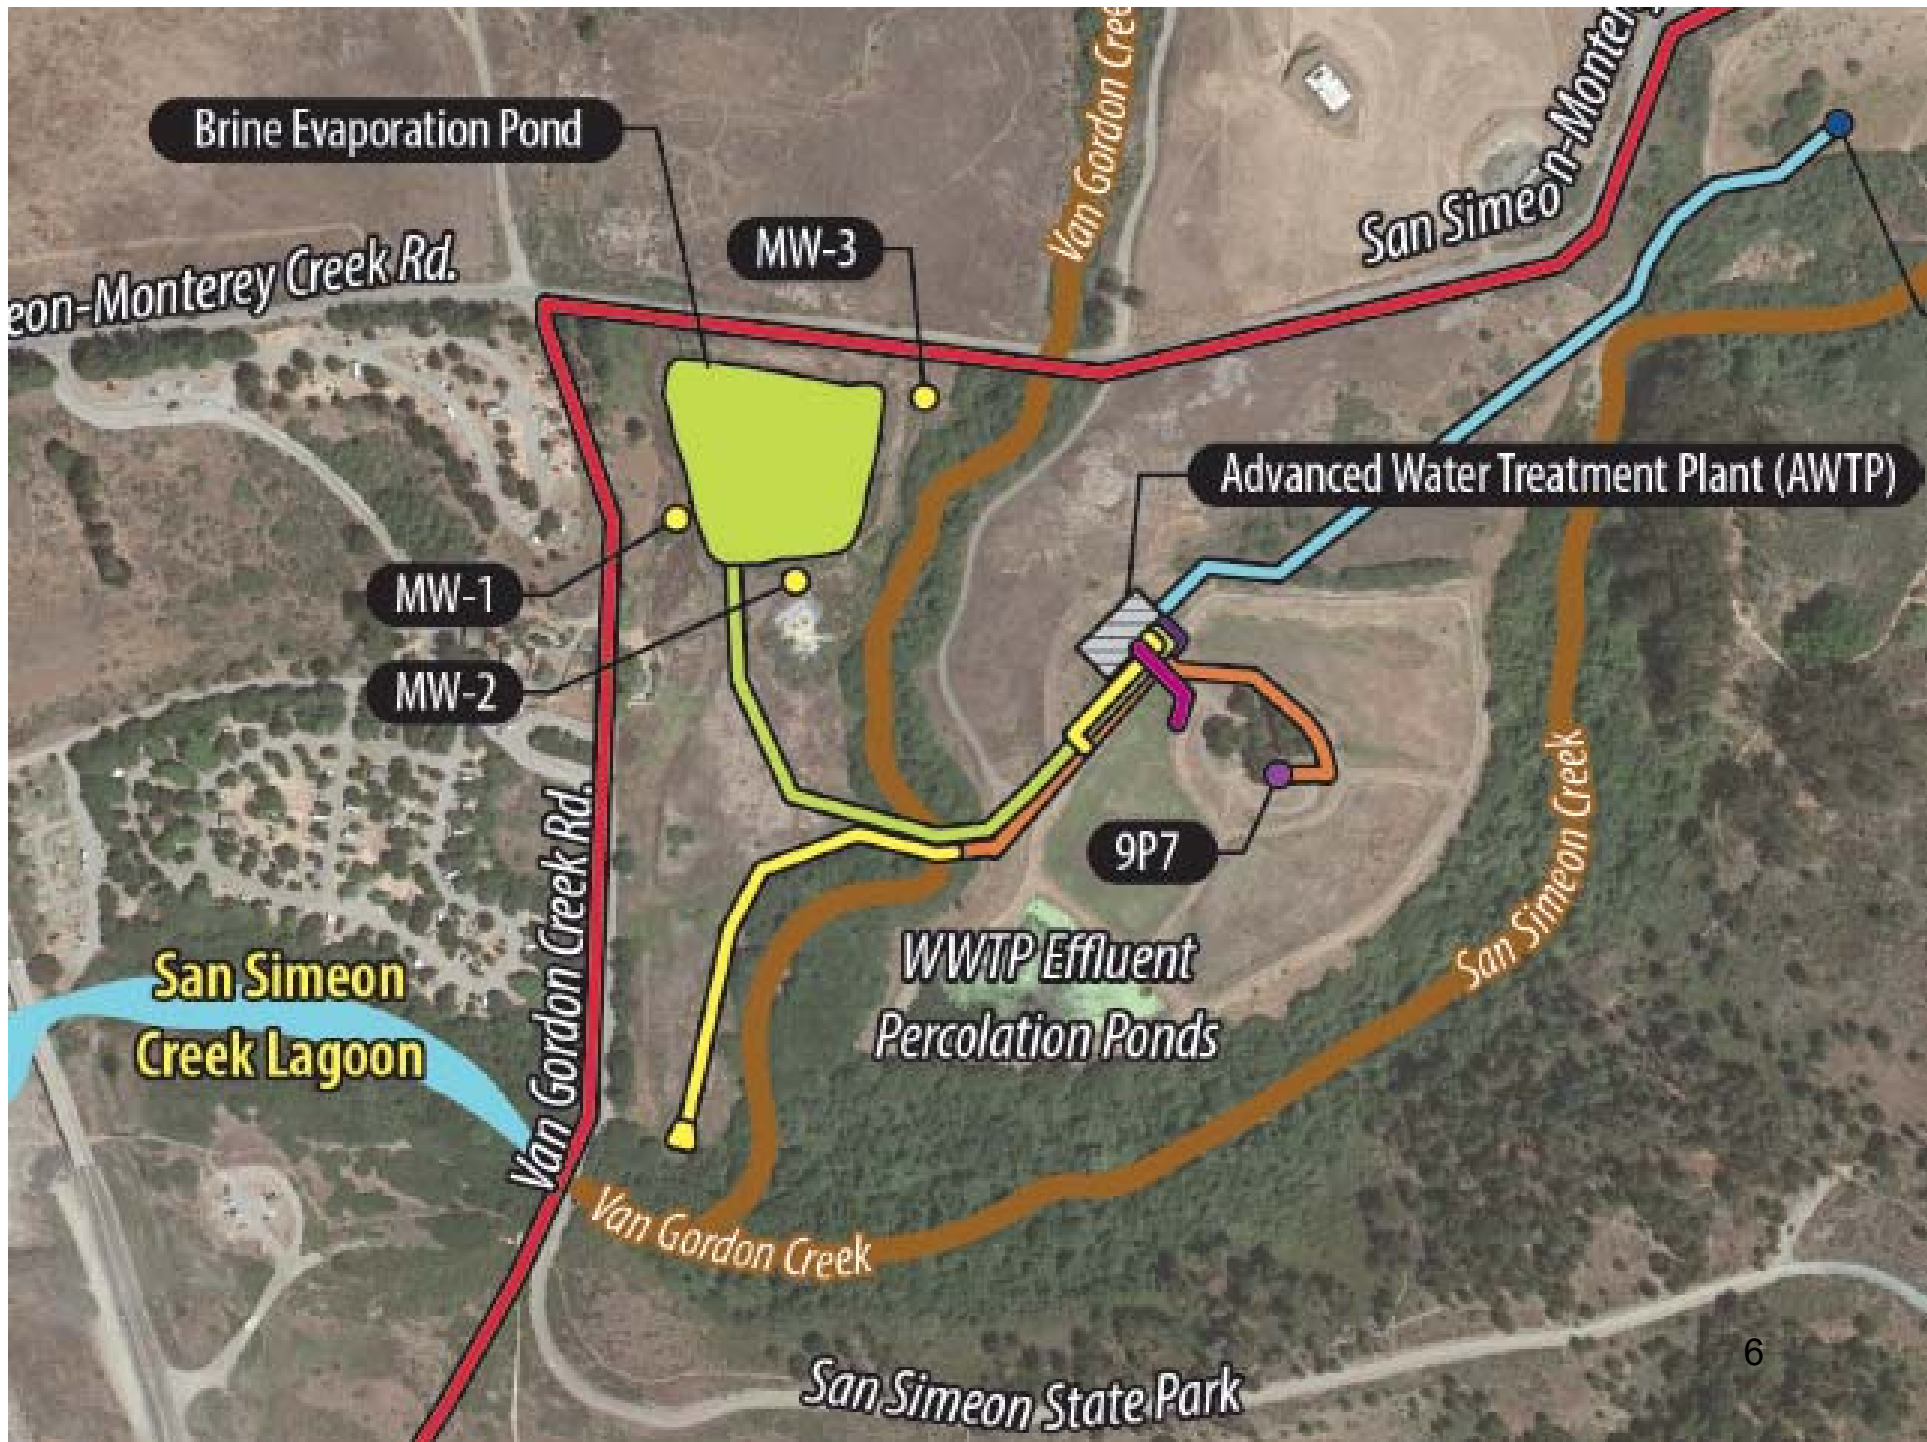

Permits

- **Emergency Water Supply System Order (R3-2014-0050)**
- **Surface Impoundment Order (R3-2014-0047)**
- **Low Threat NPDES Order for Discharges to San Simeon Lagoon (R3-2011-0223)**



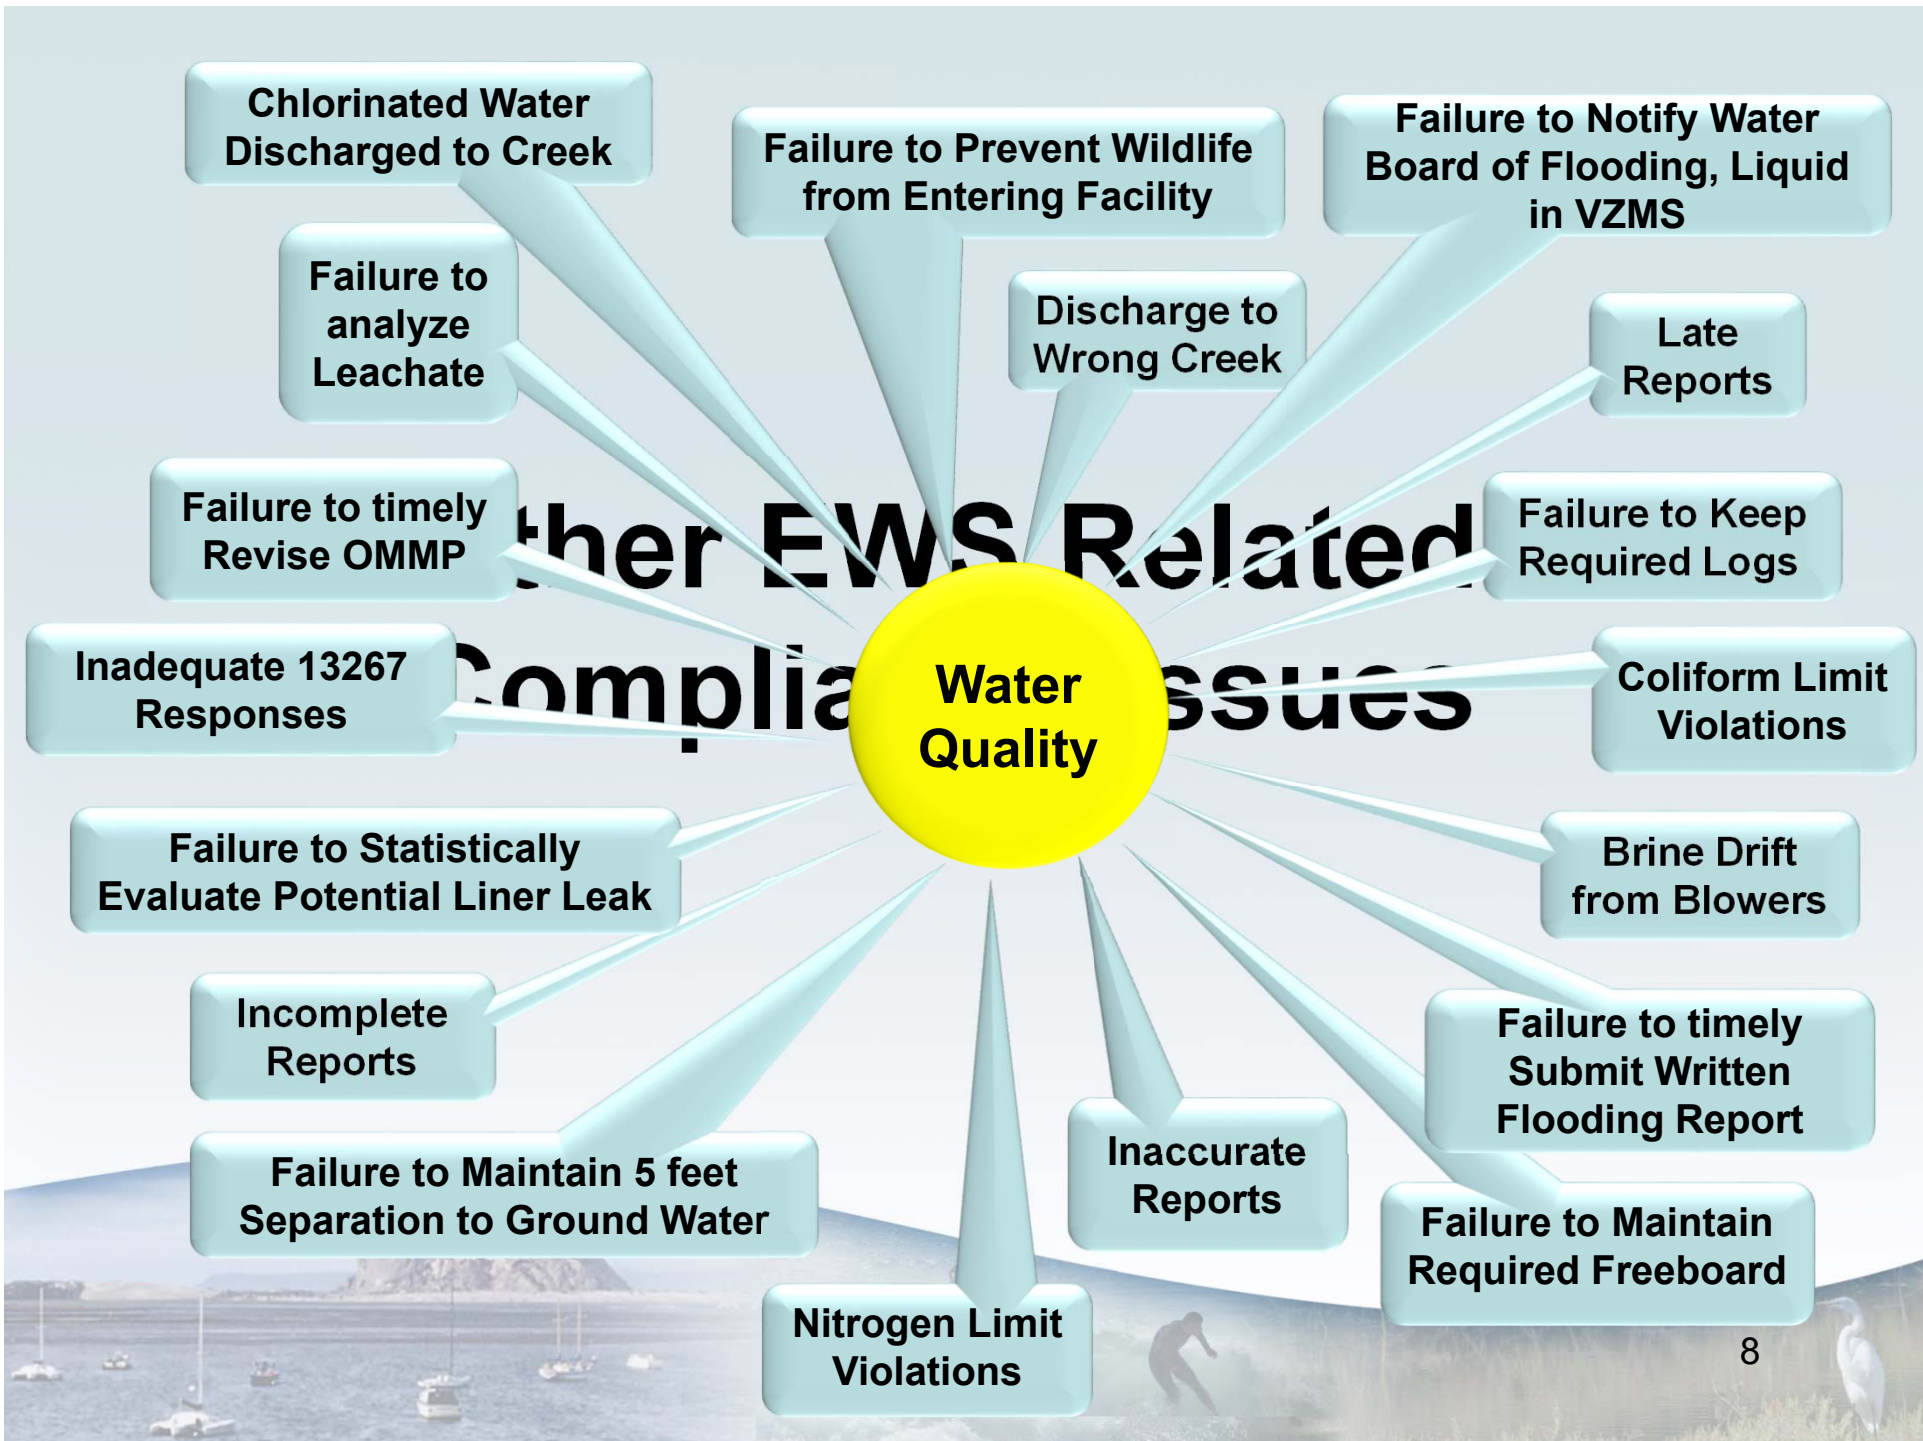

Progressive Enforcement Actions to Date

**Water
Quality**

NOV - Van Gordon
Creek Chlorinated
Water Discharge

13267
Letter #1

ACLC for
Discharges to Van
Gordon Creek

NOV - Failed to
Submit Effluent Limit
Data in Monthly SMR

Cease and Desist Order
for Surface Impoundment
ITEM #10

13267
Letter #2

NOV - Missing
Groundwater Data

NOV - Failed to submit 1st
semi-annual SMR On Time

ACLC for
Chronically Late
Reports
ITEM #9

NOV - Failed to Submit Complete
Response to 13267 #2

Failure to Adequately
Respond to 13267 Letter

NOV - for Chronic
Late Reporting

NOV - Failure to Notify Water Board
within 24-hours of Identifying Flooding

NOV - Failure to submit
Wet Weather Report on Time

Item #9

Informational Item

**Cambria Community Services District
Administrative Civil Liability
Complaint No. R3-2017-0015**

Thea Tryon, Enforcement Coordinator

July 13-14, 2017

10

Complaint Overview

- **Limited enforcement**
- **Address violations of WDR Order No. R3-2014-0050 for chronic failure to submit reports on time**
- **Monitoring and reporting very important for protection of drinking water users**



Regular Reporting Requirements

- **WDR requires:**
 - Monthly Reports
 - Quarterly Reports
 - Annual Reports



Late Reports

(January 2015 – June 2017)

Report	Number of Reports Due	Number of Reports Late	Total Number of Days Late
Monthly	29	21	309
Quarterly	9	6	81
Annual	2	1	5



Water Board Staff Assistance

- **December 2014** - WDR review in field
- **January 2015** - System startup
- **October 2015** - Revised monitoring program
- **October 2016** - Spreadsheet
- **February 2017** - Notice of violation
- **April 2017** - Complaint



Complaint Overview

- **Criteria used to identify six late reports for enforcement:**
 - Monthly late reports
 - After October 2015 revision of monitoring program
 - System in operation



Penalty Amount

- **\$53,596**
- **Enforcement Policy penalty methodology**
- **Cambria CSD agreed not to contest Complaint and paid full amount and waived right to hearing on May 3, 2017**



Administrative Civil Liability Complaint No. R3-2017-0015

Comments?

