


# Project Location Map

April 2015

Pure Water Monterey GWR Project  
Draft EIR

Figure  
**2-1**



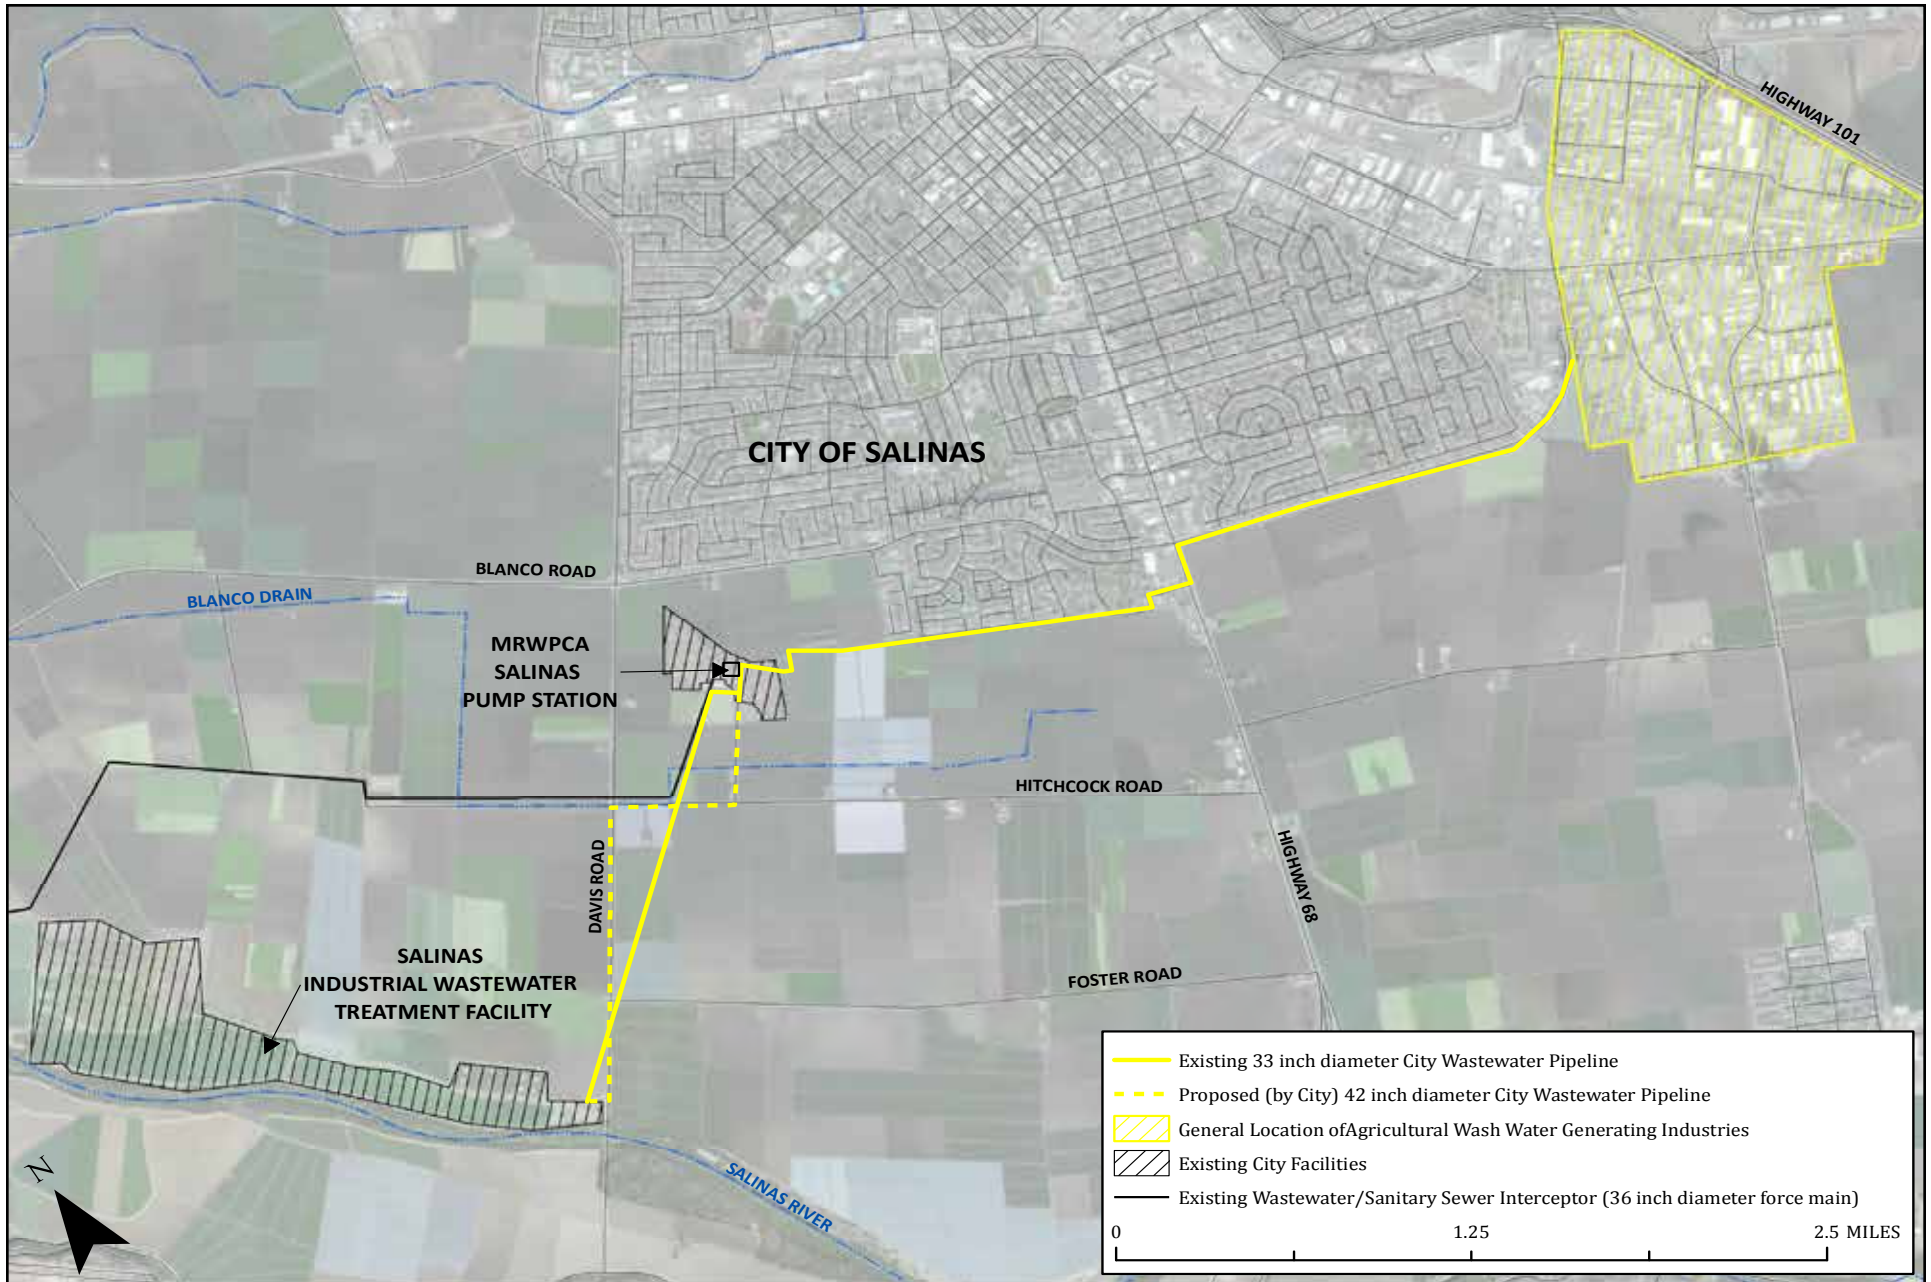


# Salinas Industrial Wastewater System Location Map

April 2015

Pure Water Monterey GWR Project  
Draft EIR

Figure  
2-14



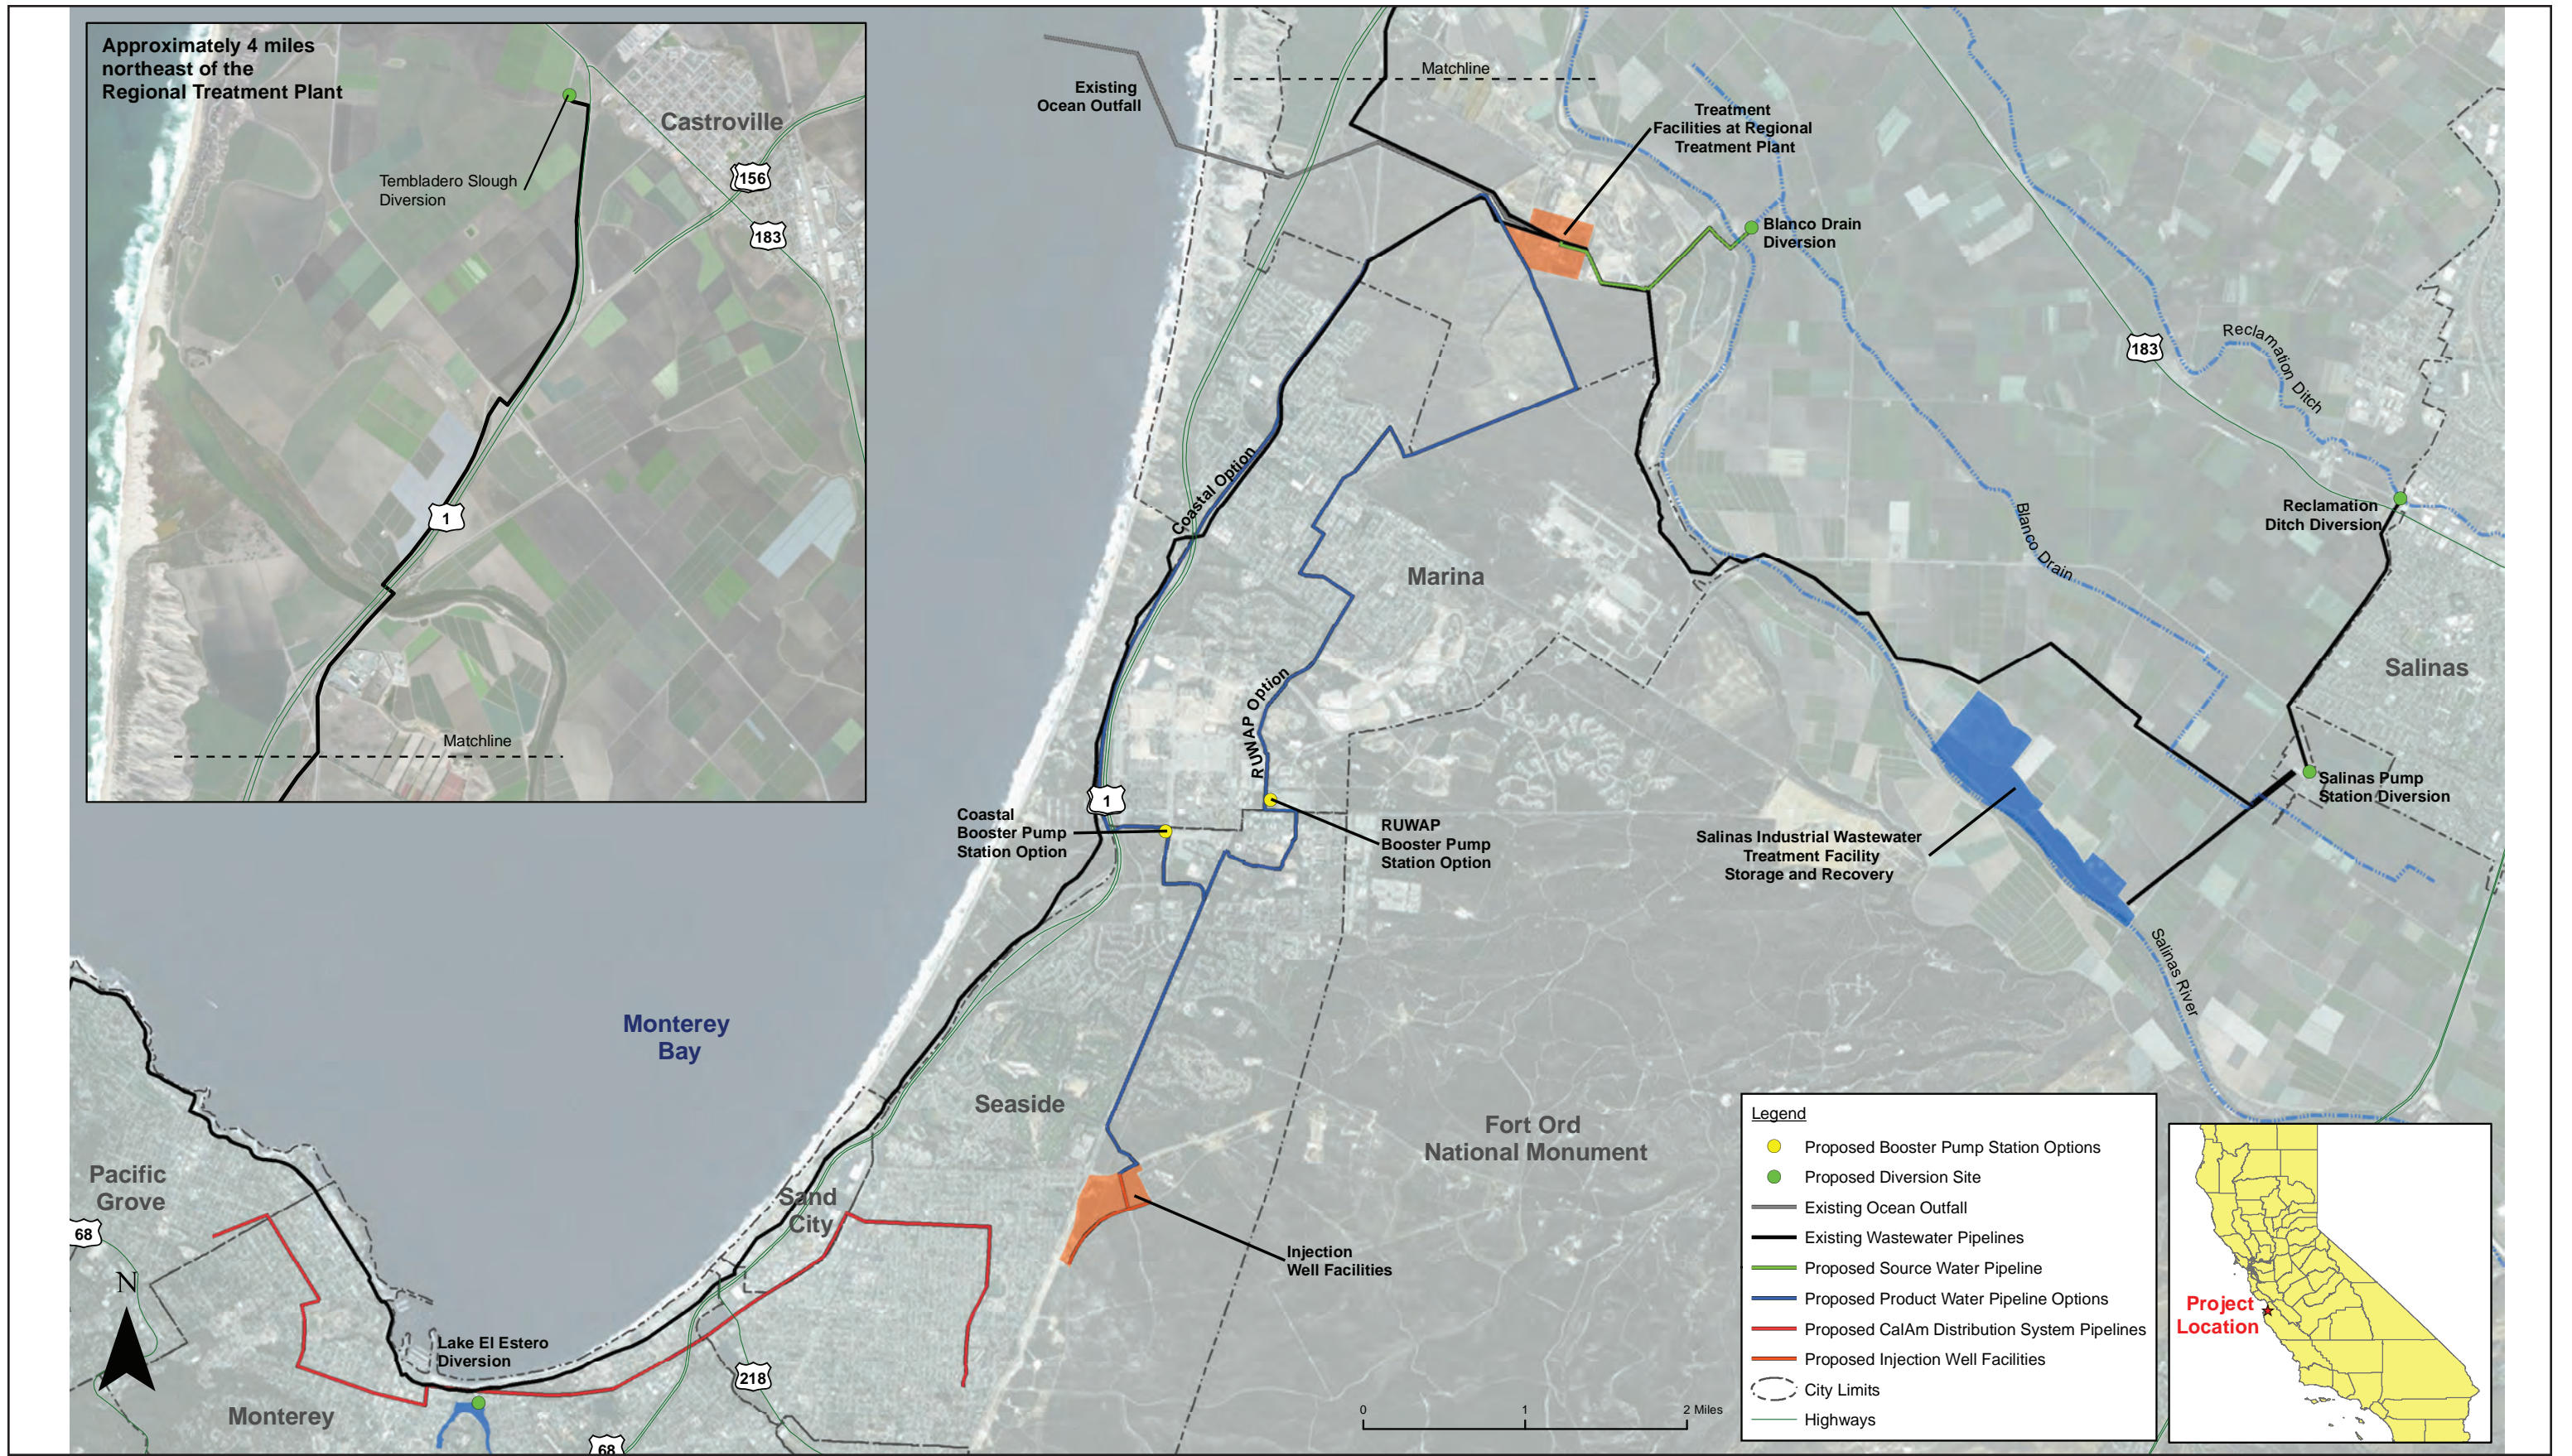

**Proposed GWR Project Facilities Overview**



April 2015

Pure Water Monterey GWR Project  
Draft EIR

Figure  
2-18






**KEY NOTES:**

- ① REMOVE EXIST. IWW DIVERSION BOX
- ② NEW 42" IWW DIVERSION PIPELINE
- ③ NEW PARSHALL FLUME
- ④ NEW STORMWATER DIVERSION STRUCTURE NO. 1
- ⑤ NEW 18" IWW FORCE MAIN
- ⑥ NEW JUNCTION STRUCTURE
- ⑦ NEW 18" FORCE MAIN INSIDE EXIST. 33" IWW PIPELINE
- ⑧ NEW STORMWATER DIVERSION STRUCTURE NO. 2
- ⑨ REHABILITATE EXIST. 30" PIPE FOR STORMWATER DIVERSION
- ⑩ NEW STORMWATER DIVERSION PIPELINE TO 42" IWW
- ⑪ CONNECT TO EXIST. 42" DIA. STUB-OUT
- ⑫ EXIST. MANHOLE TO BE REMOVED
- ⑬ CONNECT TO EXIST. MANHOLE

**LEGEND**

- ● EXISTING MANHOLES
- EXISTING STORM DRAIN
- EXISTING SANITARY SEWER
- EXISTING IWW PIPELINE
- NEW PIPING
- NEW STRUCTURE



Source: E2 Consulting Engineers, Inc., 2014



# Proposed Salinas Pump Station Site Plan

April 2015

Pure Water Monterey GWR Project  
Draft EIR

Figure  
2-21






**KEY NOTES:**

- |   |  |
|---|--|
| ① NEW POND 3 PUMP STATION INLET BOX                                 | ⑫ EXIST. IWW PUMP STATION                          |
| ② NEW POND 3 PUMP STATION WET WELL                                  | ⑬ EXIST. 24" IWW INLET PIPELINE                    |
| ③ NEW 18" FORCE MAIN  | ⑭ EXIST. 18" IWW OUTLET PIPELINE                   |
| ④ NEW DIVERSION STRUCTURE NO. 3                                     | ⑮ EXIST. 30" IWW DISTRIBUTION PIPELINE             |
| ⑤ EXISTING PRESSURE M.H. ON 30" LINE                                | ⑯ EXIST. INLET TO POND                             |
| ⑥ NEW 30" GRAVITY MAIN  | ⑰ EXIST. RISER MANHOLE                             |
| ⑦ RETURN PUMP STATION WET WELL                                      | ⑱ EXIST. 24" IWW DISTRIBUTION PIPELINE             |
| ⑧ RETURN PUMP STATION VALVE VAULT                                   | ⑲ EXIST. POND INLET STRUCTURE                      |
| ⑨ NEW FLOW METER VAULT  | ⑳ EXIST. POND 3 PUMP STATION                       |
| ⑩ NEW 18" FORCE MAIN INSIDE EXIST. 33" IWW PIPELINE TO SALINAS P.S. | ㉑ EXIST. IRRIGATION BEDS DISTRIBUTION STRUCTURE    |
| ⑪ EXIST. 42" IWW PIPELINE   | ㉒ EXIST. DISTRIBUTION PIPELINES TO IRRIGATION BEDS |

- LEGEND**
- ● ● EXISTING MANHOLES
  - EXISTING STORM DRAIN
  - EXISTING SANITARY SEWER
  - EXISTING IWW PIPELINE
  - NEW PIPING
  - NEW STRUCTURE



Source: E2 Consulting Engineers, Inc. 2014





# Injection Well Site Plan

April 2015

Pure Water Monterey GWR Project  
Draft EIR

Figure  
2-32